

NOTES:

DESIGN:

TANK AND TOWER SHALL BE DESIGNED, FABRICATED AND ERECTED IN ACCORDANCE WITH AWWA D100-96 AND PROJECT SPECIFICATIONS.

WIND LOAD: _____

SNOW LOAD: _____


SEISMIC ZONE: _____

MATERIALS:

- STEEL PLATE: ASTM A283 GR. C / A36
- STRUCTURAL STEEL SHAPES: ASTM A36
- BRACE RODS AND STAY RODS: ASTM A36
- LADDER RUNGS: ASTM A706

GENERAL:

- ACCESSORIES SHOWN ON ELEVATION DRAWING ARE ROTATED FOR CLARITY.
- ALL HANDRAILS, PLATFORM LANDINGS, WALKWAYS, LADDERS, AND SAFETY CLIMB DEVICES SHALL CONFORM WITH CURRENT OSHA STANDARDS.
- SEE PROJECT SPECIFICATIONS FOR SHOP AND FIELD PAINT REQUIREMENTS.
- STERILIZE TANK IN ACCORDANCE WITH AWWA C652-92 AND PROJECT SPECIFICATIONS.
- FOR TANKS LOCATED IN REGIONS WHERE FREEZING CONDITIONS MAY OCCUR CONSIDERATION SHALL BE GIVEN TO OMISSION OF INSIDE TANK & RISER LADDERS.

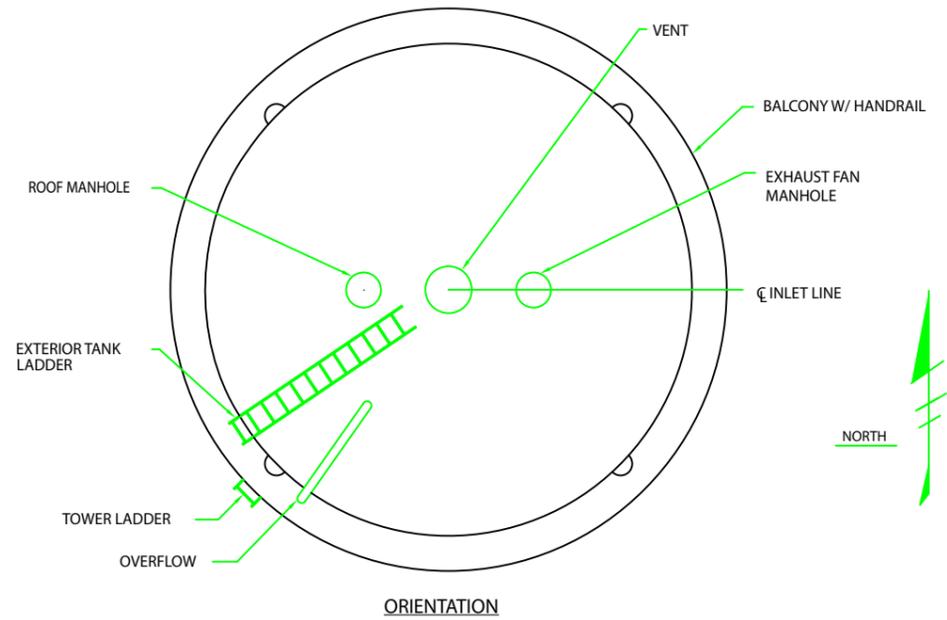

REV. BY:	DATE	REMARKS
CALDWELL TANKS, INC. LOUISVILLE, KY. NEWNAN, GA.		
BY:	TITLE: ELEVATION DETAILS	
DATE:	DRAWING NO.: DE-1.DWG	