

**NOTES:**

**DESIGN:**

TANK AND TOWER SHALL BE DESIGNED, FABRICATED AND ERECTED IN ACCORDANCE WITH AWWA D100-96 AND PROJECT SPECIFICATIONS.


WIND LOAD: \_\_\_\_\_  
 SNOW LOAD: \_\_\_\_\_  
 SEISMIC ZONE: \_\_\_\_\_

**MATERIALS:**

STEEL PLATE: ASTM A283 GR. C / A36  
 STRUCTURAL STEEL SHAPES: ASTM A36  
 BRACE RODS AND STAY RODS: ASTM A36  
 LADDER RUNGS: ASTM A706

**GENERAL:**

- ACCESSORIES SHOWN ON ELEVATION DRAWING ARE ROTATED FOR CLARITY.
- ALL HANDRAILS, PLATFORM LANDINGS, WALKWAYS, LADDERS, AND SAFETY CLIMB DEVICES SHALL CONFORM WITH CURRENT OSHA STANDARDS.
- SEE PROJECT SPECIFICATIONS FOR SHOP AND FIELD PAINT REQUIREMENTS.
- STERILIZE TANK IN ACCORDANCE WITH AWWA C652-92 AND PROJECT SPECIFICATIONS.
- FOR TANKS LOCATED IN REGIONS WHERE FREEZING CONDITIONS MAY OCCUR CONSIDERATION SHALL BE GIVEN TO OMISSION OF INSIDE TANK LADDER.
- NUMBER OF TOWER LEGS PER MANUFACTURER'S STANDARD DESIGN.

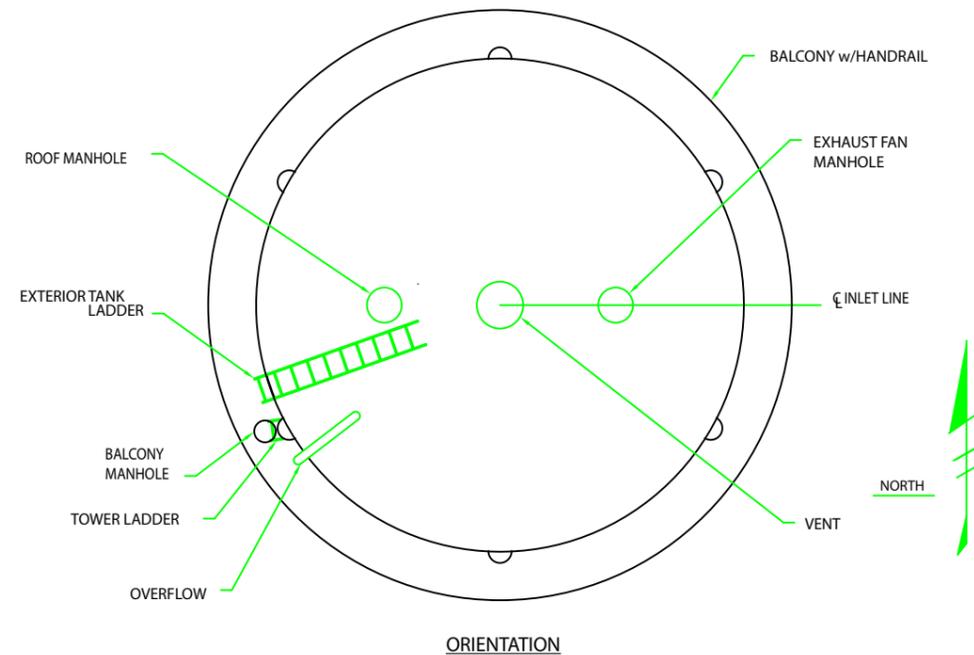

ORIENTATION

REV. BY:	DATE	REMARKS
<b>CALDWELL TANKS, INC.</b> LOUISVILLE, KY. NEWNAN, GA.		
BY:	TITLE: ELEVATION DETAILS	
DATE:	DRAWING NO.:	TB-1.DWG