

**NOTES:**

**DESIGN:**  
TANK AND TOWER SHALL BE DESIGNED, FABRICATED AND ERECTED IN ACCORDANCE WITH AWWA D100-21 AND PROJECT SPECIFICATIONS.


WIND LOAD: \_\_\_\_\_  
SNOW LOAD: \_\_\_\_\_  
SEISMIC ZONE: \_\_\_\_\_

**MATERIALS:**

STEEL PLATE: ASTM A283 GR. C / A36  
STRUCTURAL STEEL SHAPES: ASTM A36  
LADDER RUNGS: ASTM A706

**GENERAL:**

- ACCESSORIES SHOWN ON ELEVATION DRAWING ARE ROTATED FOR CLARITY.
- ALL HANDRAILS, PLATFORM LANDINGS, LADDERS AND SAFETY CLIMB DEVICES SHALL COMFORM WITH CURRENT OSHA STANDARDS.
- SEE PROJECT SPECIFICATIONS FOR SHOP AND FIELD PAINT REQUIREMENTS.
- STERILIZE TANK IN ACCORDANCE WITH AWWA C652-92 AND PROJECT SPECIFICATIONS.

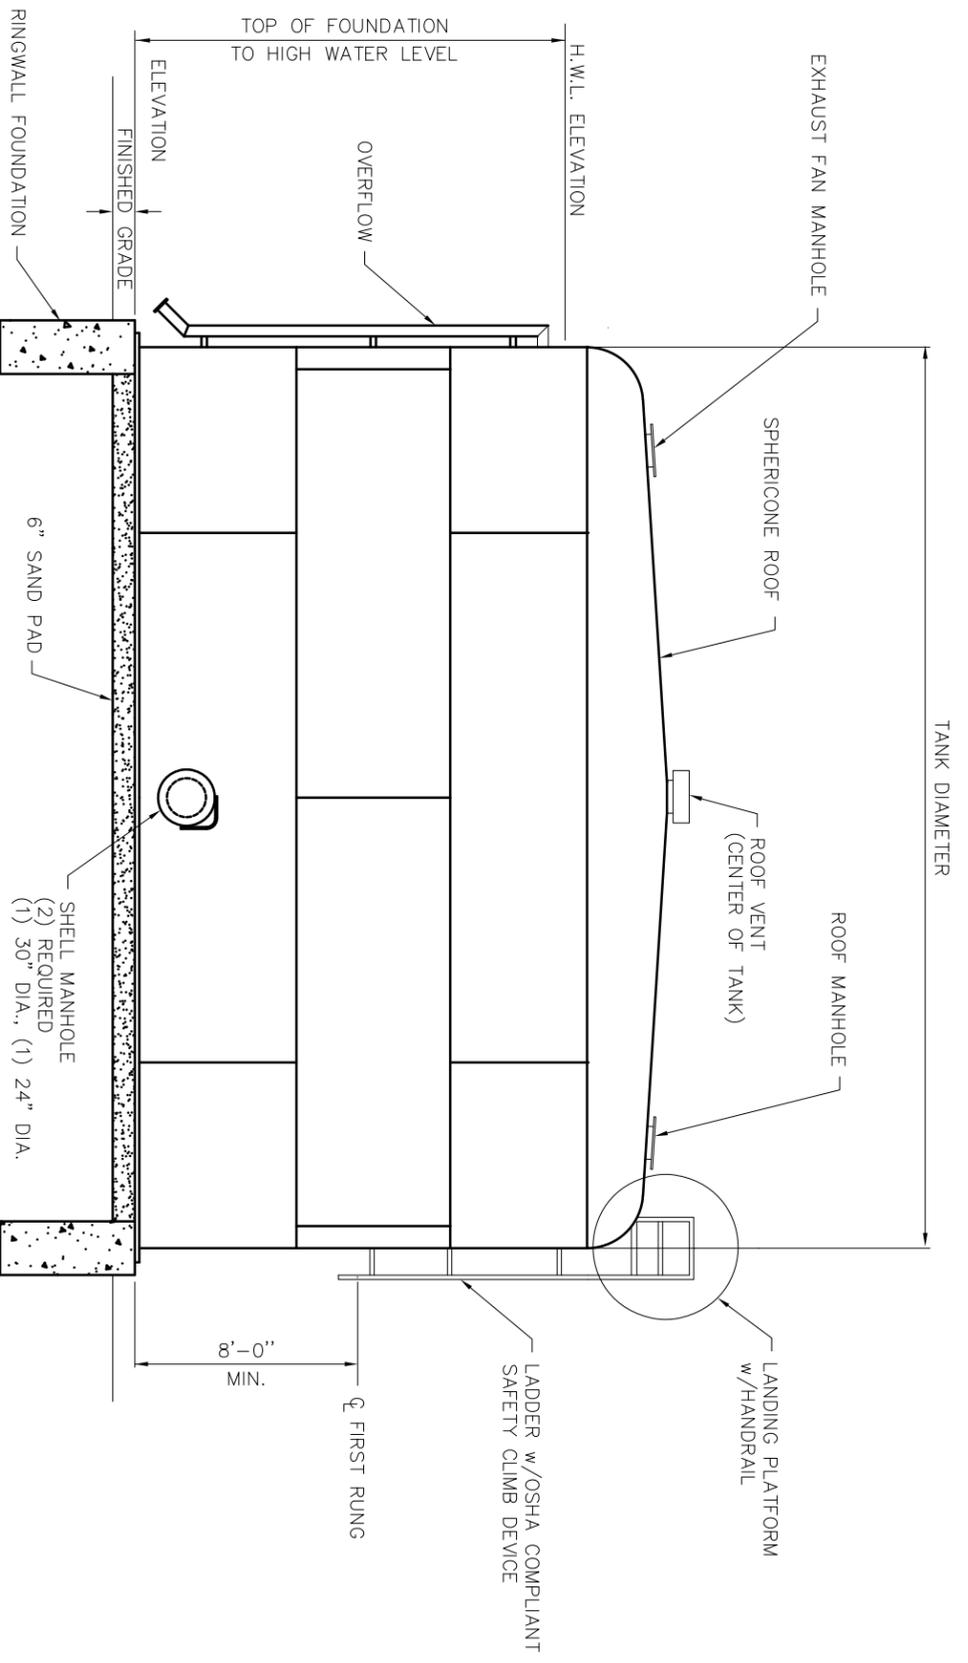

ELEVATION

BY:		TITLE: ELEVATION DETAILS	
DATE:		DRAWING NO.: RES-1.DWG	
REV.	BY:	DATE	REMARKS
<b>CALDWELL TANKS, INC.</b> LOUISVILLE, KY.    NEWNAN, GA.			